
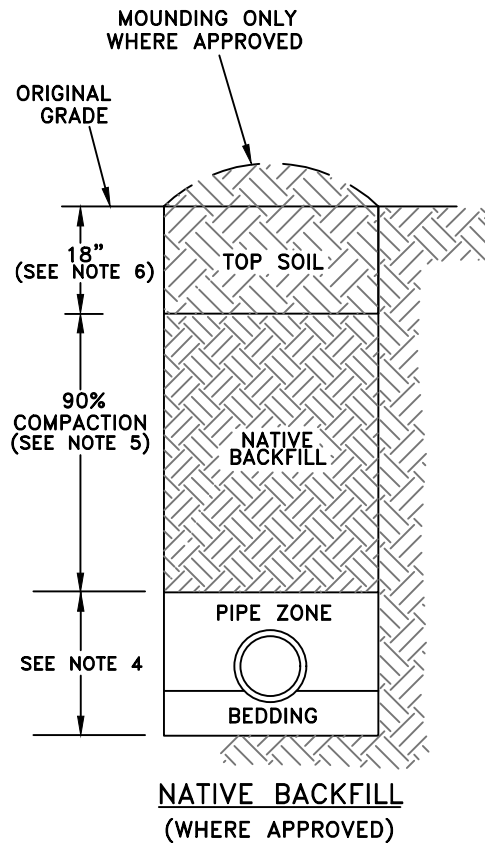


FOR SURFACE STRUCTURE SEE
STANDARD DRAWING NO. 206 AND 207

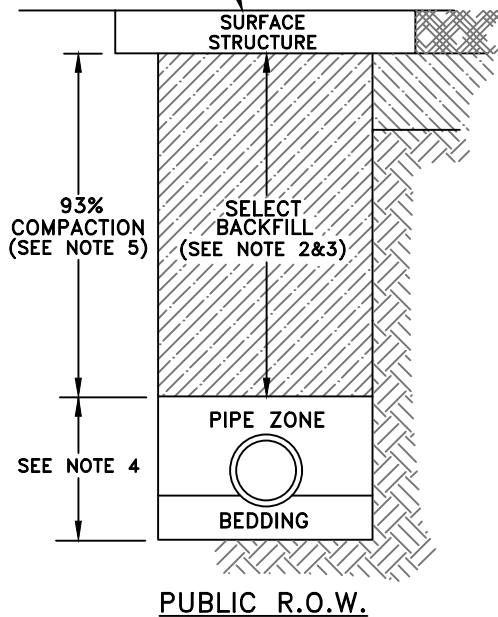

NOTES:

1. FULL PANEL REPLACEMENT IS REQUIRED ON CONCRETE SURFACES. SEE STANDARD DRAWING NO. 207.
2. SELECT BACKFILL IN THE TOP 8' OF TRENCH SHALL BE 1"-0" CRUSHED AGGREGATE.
3. BACKFILL BETWEEN THE PIPE ZONE AND 8' BELOW FINISHED GRADE MAY BE BANK-RUN GRAVEL, RIVER RUN GRAVEL, 1" MINUS OR ¾" MINUS.
4. FOR BEDDING AND PIPE ZONE REQUIREMENTS, SEE DETAIL DWG. NO. 204.
5. ALL COMPACTION REQUIREMENTS SHALL BE PER MODIFIED PROCTOR TEST METHOD ASTM D1557.
6. APPROVED TOPSOIL SHALL BE LIGHTLY COMPACTED TO RESIST SETTLEMENT. EXISTING TOPSOIL MAY BE SALVAGED WITH APPROVAL OF ENGINEER.

CITY OF ALBANY, OREGON
PUBLIC WORKS DEPARTMENT

STANDARD UTILITY TRENCH
BACKFILL DETAIL

NO SCALE

FEBRUARY 2024

NO. 205