
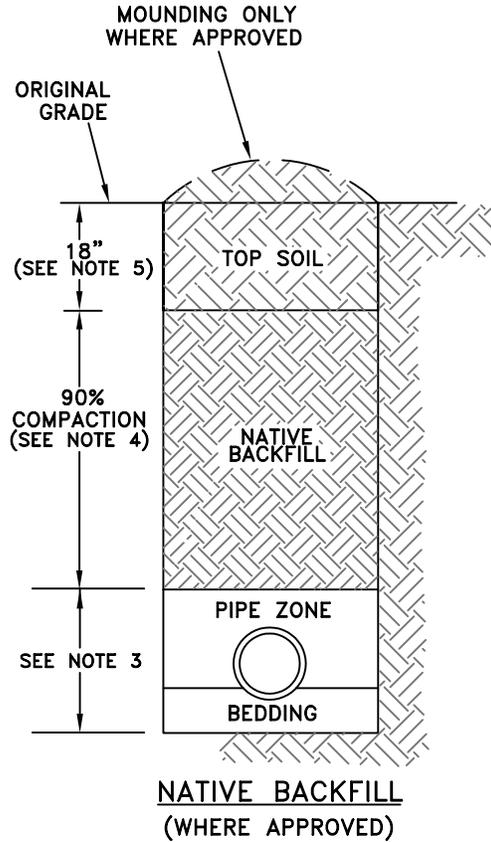


FOR SURFACE STRUCTURE SEE
DETAIL DWG. NOS. 206 AND 207

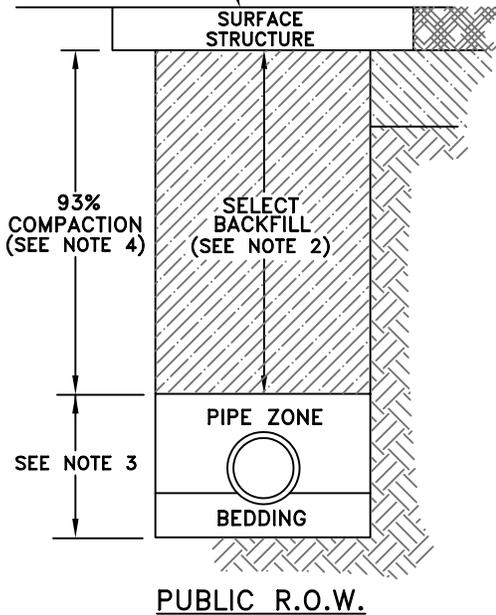

NOTES:

1. FULL PANEL REPLACEMENT IS REQUIRED ON CONCRETE SURFACES. SEE DETAIL DWG. NO. 207.
2. SELECT BACKFILL IN THE TOP 8' OF TRENCH SHALL BE 1"-0" CRUSHED AGGREGATE.
3. FOR BEDDING AND PIPE ZONE REQUIREMENTS, SEE DETAIL DWG. NO. 204.
4. ALL COMPACTION REQUIREMENTS SHALL BE PER MODIFIED PROCTOR TEST METHOD ASTM D1557.
5. APPROVED TOP SOIL SHALL BE LIGHTLY COMPACTED TO RESIST SETTLEMENT. EXISTING TOP SOIL MAY BE SALVAGED WITH APPROVAL OF ENGINEER.

CITY OF ALBANY, OREGON
PUBLIC WORKS DEPARTMENT

STANDARD UTILITY TRENCH
BACKFILL DETAIL

NO SCALE

MAY 1998

NO. 205