


1. WHEN PLACED ADJACENT TO THE CURB, THE HYDRANT PORT SHALL BE 12"-18" FROM THE FACE OF THE CURB.
2. THE FACE OF CURB SHALL BE PAINTED YELLOW PER 503.02.02 FOR A DISTANCE OF 10 FEET FROM THE HYDRANT IN EITHER DIRECTION, OR TO THE NEAREST CURB RETURN, WHICHEVER IS CLOSER.
3. EXTENSIONS REQUIRED FOR HYDRANTS SET TOO LOW SHALL BE SUPPLIED BY THE CONTRACTOR. EXTENSIONS SHALL BE INSTALLED TO THE MANUFACTURER'S SPECIFICATIONS.
4. FIRE HYDRANTS SHALL NOT BE LOCATED WITHIN SIDEWALKS OR OTHER WALKWAYS WITHOUT APPROVAL OF THE ENGINEER.
5. HYDRANTS SHALL BE "SAFETY YELLOW" IN COLOR, PAINTED BY THE MANUFACTURER.
6. A 5-INCH STORZ ADAPTER SHALL BE INSTALLED ON THE MAIN PUMPER NOZZLE. STORZ ADAPTER SHALL BE HYDRA SHIELD MODEL HYST-5045-ST CAP.
7. HYDRANTS LOCATED WITHIN PLANTER STRIPS OR OPEN SPACES SHALL HAVE A MIN. 24" X 24" X 4" CONCRETE COLLAR.

NOTES:

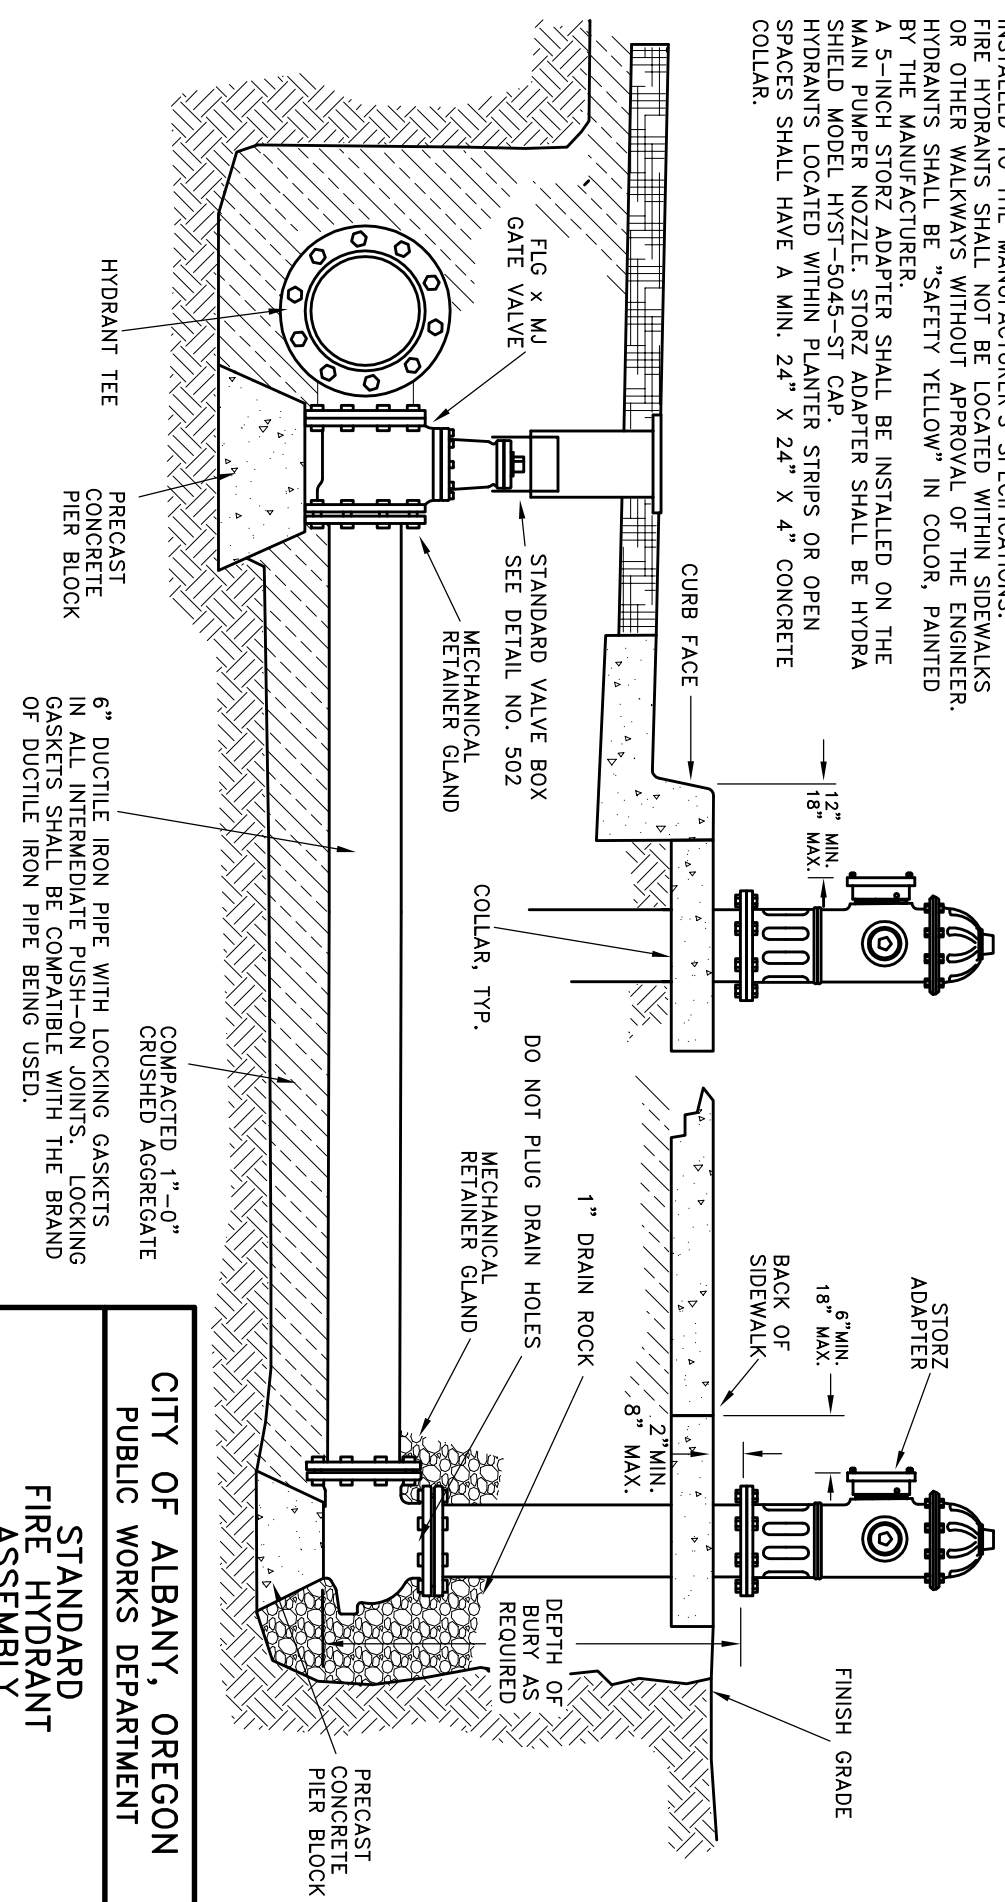

6" DUCTILE IRON PIPE WITH LOCKING GASKETS IN ALL INTERMEDIATE PUSH-ON JOINTS. LOCKING GASKETS SHALL BE COMPATIBLE WITH THE BRAND OF DUCTILE IRON PIPE BEING USED.

<b>CITY OF ALBANY, OREGON</b> <b>PUBLIC WORKS DEPARTMENT</b>		
<b>STANDARD</b> <b>FIRE HYDRANT</b> <b>ASSEMBLY</b>		
NO SCALE	JANUARY 2018	NO. 504